

96" MINIMUM (FACBC 11.4.17.3(1)(Fig.30A) 52" MIN FACBC 11.4.17.6₁₂" MAX.

42" RECOMMENDED DIMENSIONS

6" 36" MIN MAX FACBC 11.4.17.6


*15


TYPICAL STALL

17" MIN MIN MIN

85" MINIMUM/88" RECOMMENDED

FACBC 11.4.17.3 (Fig.30a) 5", 42" MIN

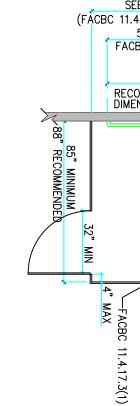

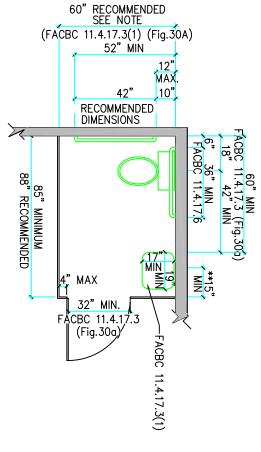

** THE SINK SHALL BE A MINIMUM OF INCHES FROM THE SIDE WALL AS REQUIRED BY SECTION P405.3.1 OF FPC. 15

ASSUMPTIONS

X

32" MIN FACBC 11.4.17.3 (Fig.30a)

4" <u>M</u>AX

36" MIN 42" RECOMMENDED

- **=** ACCESSIBLE WATER CLOSET DEPTH IS 30 INCHES AND IT IS FLOOR MOUNTED.
- 2 CONTROLS FOR FLUSH VALVES SHALL BE (FACBC 11.4.16.5). ON THE WIDE SIDE OF THE TOILET AREAS
- ACCESSIBILITY TO TOILET STALL DOOR IS IN COMPLIANCE WITH FACBC AND ADA GUIDELINES.

હ

TOILET ACCESSORIES TO BE PROVIDED

MOUNTED WATER CLOSET. IF THE DEPTH OF OF A STANDARD ACCESSIBLE TOILET STALL IS INCREASED AT LEAST 3 INCHES, THEN A FLOOR MOUNTED WATER CLOSET MAY BE USED. WE RECOMMEND A DEPTH OF 60" (11.4.17.3). DO NOT FORGET THE REQUIREMENT OF THE "6th" STALL TO BE ACCESSIBLE (FACBC 11.4.22.4 AND/OR 11.4.23.4). NOTE:
ACCESSIBLE TOILET STALL (COMPARTMENT)
CAN BE 56" IN DEPTH IF YOU HAVE A WALL

03-06-04

Larry M. Schneider AIA Copyright 2004